




C.L.F. 20285

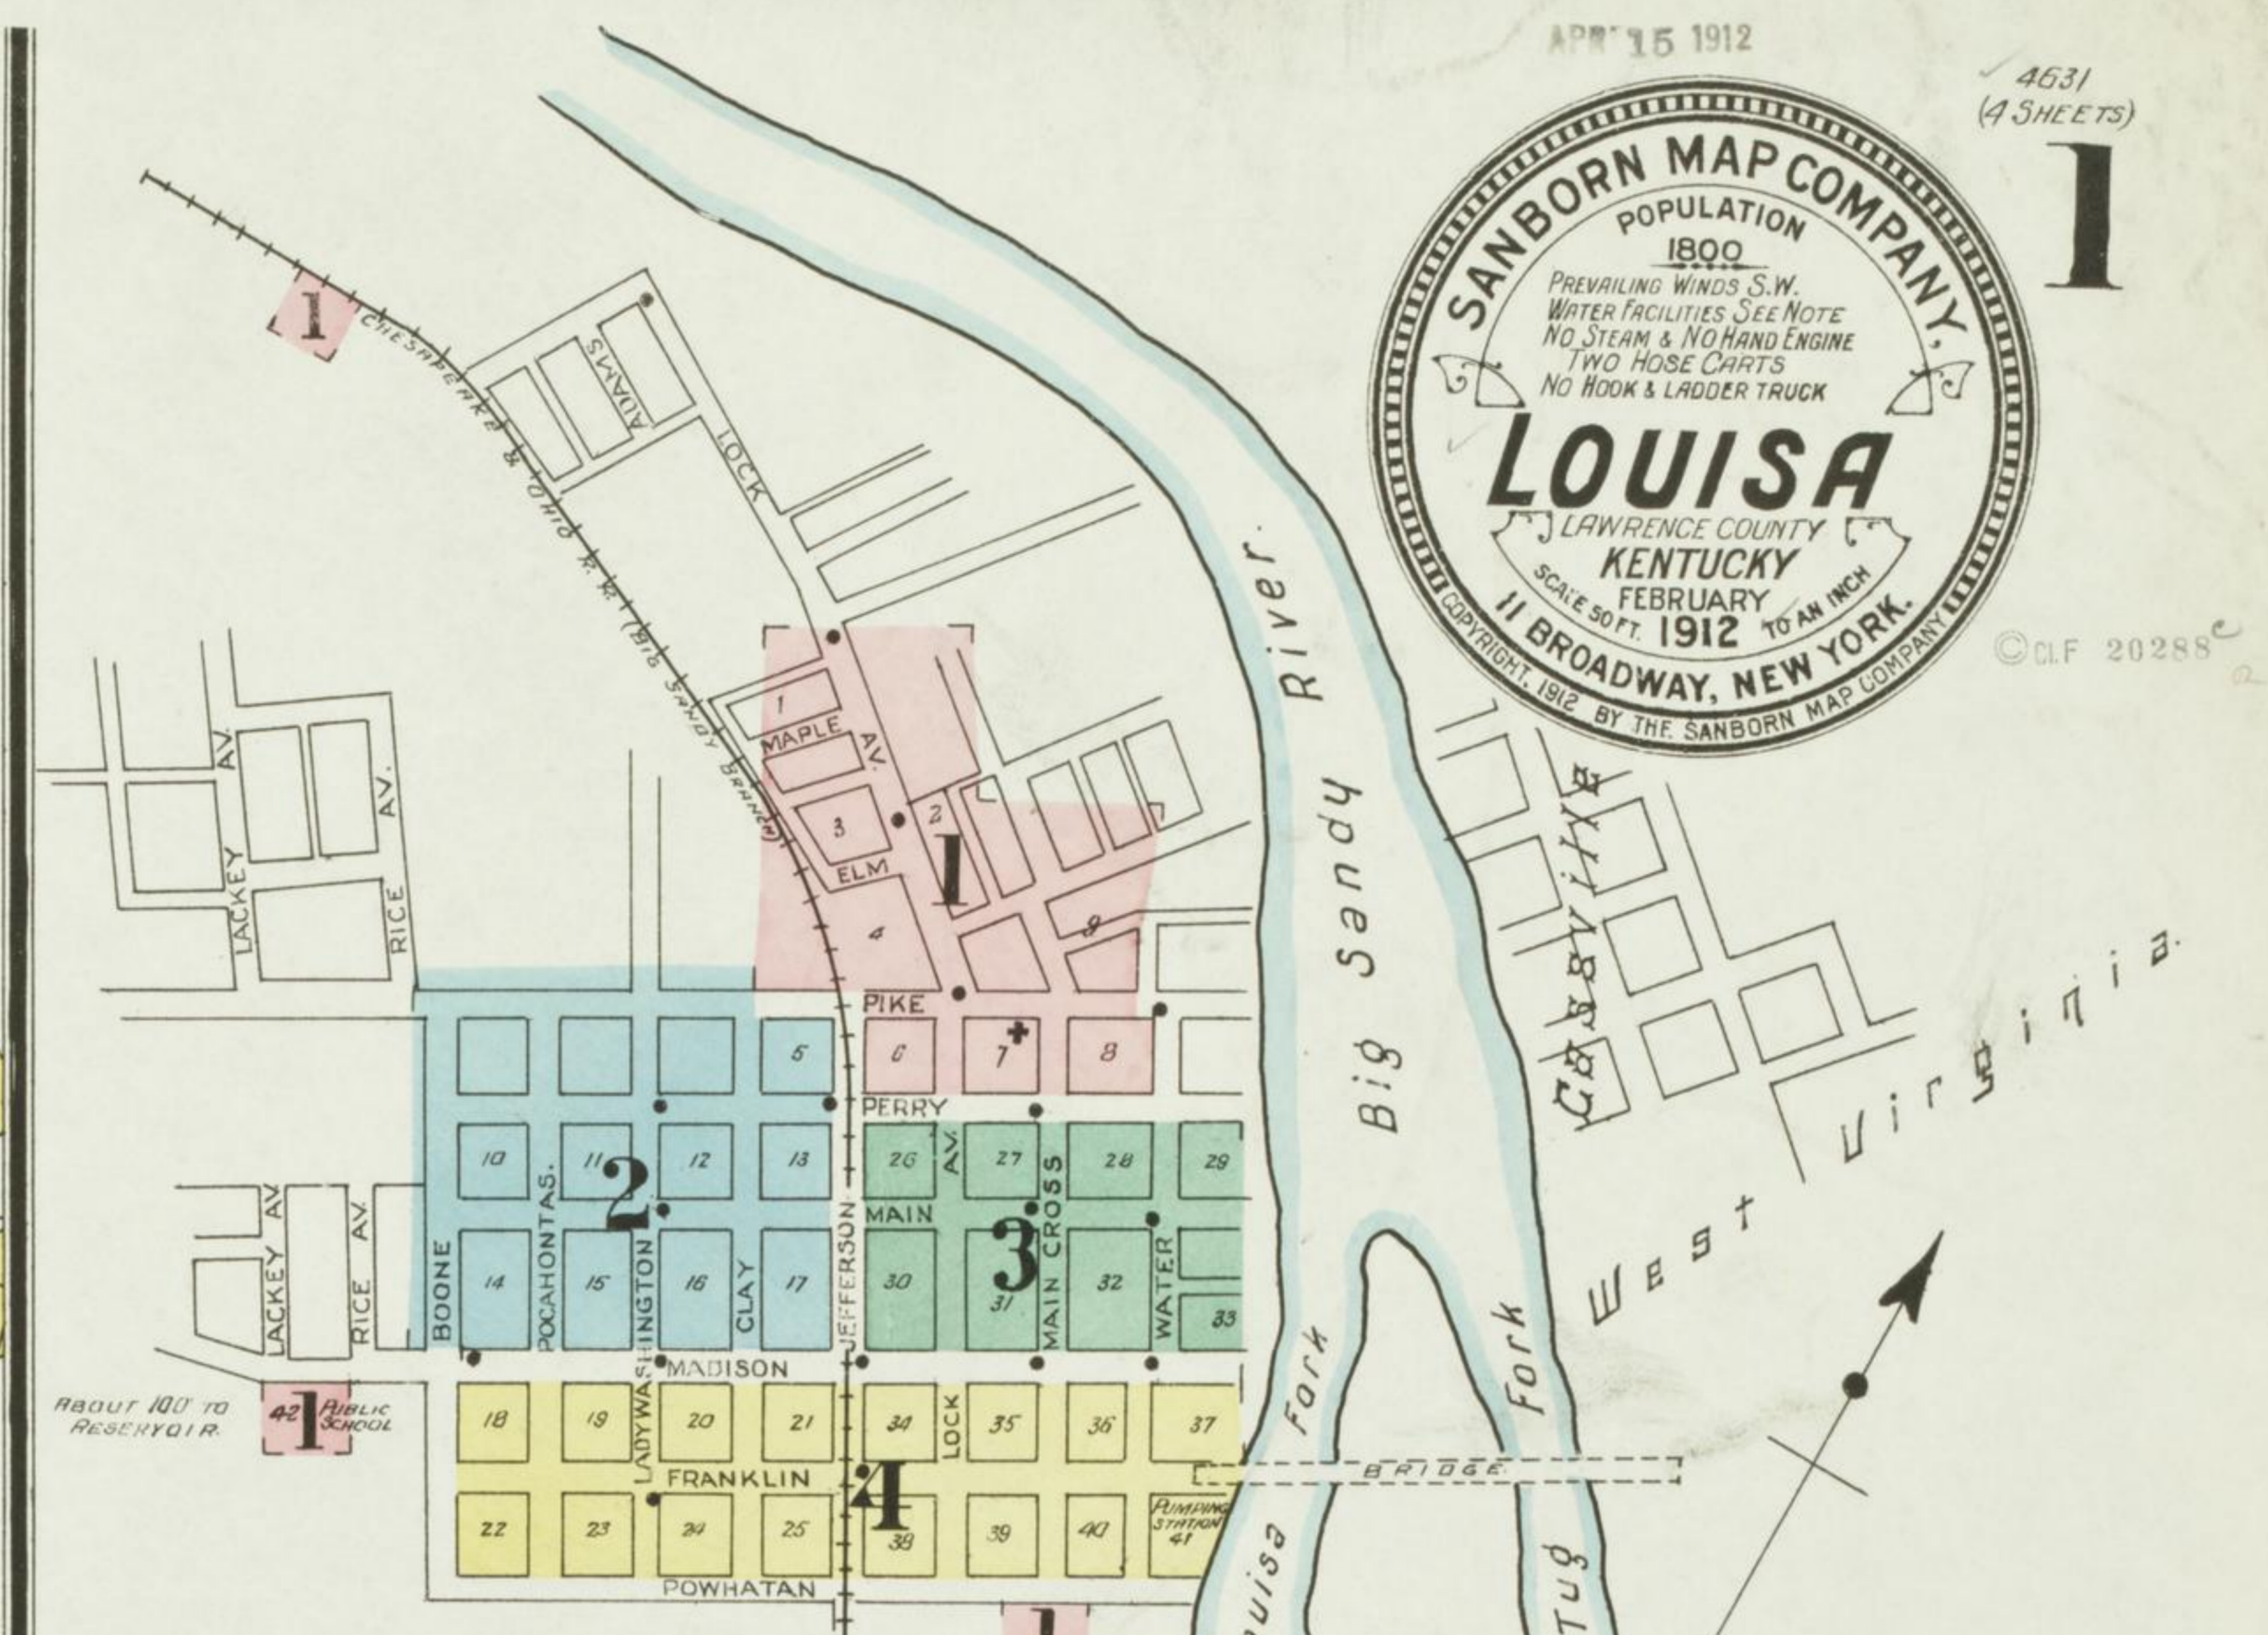

WATER FACILITIES:
Gravity or direct pressure system of water works owned by private corporation. Water is pumped from Big Sandy River by 1 Duplex Fairbanks Morse pump 8x12 capacity, 300 gals. per min. - driven by direct conn. Fairbanks Morse natural gas eng. 40 hp into a 200,000 gal. reservoir, elevated about 300' above general level of town. System built in 1904. 5 miles 4' 10" pipe - pressure at Court No. 150 lbs. - 17 double hydrants - 6' independent reservoir discharge line - 6' independent reservoir supply line - Daily consumption 400,000 gals.

FIRE DEPT.:
Volunteer - 20 men - 2 hose carts, 1,000' 2 1/2" C.R.L. hose - No alarm - Streets level & unpaved - Public lights: gas.

INDEX.

SPECIALS.	SHEET	County Court House and Jail,	3	Louisa Public School,	1	Post Office,	P	4
Baptist Church,	2	Fire Department,	1	Methodist Episcopal Church,	M	Riverview Hospital,	R	4
Big Sandy Milling Co.,	1	Burchett, D. J., Jr., Feed Mill,	4	Hotel Brunswick,	H	Negro Meeting House,	N	2
C. & O. R. R. Freight Station,	1	City Hall,	1	Louisa Canning Co.,	1	Opera House,	O	4
City Hall,	1	Coca-Cola Warehouse and Bottling,	1			Standard Oil Co.,	S	3
						Water Works,	W	4



Scale of Feet. 50 40 30 20 10 0 50 100 150